

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

पं. 695 No W-50/27

Dated : 20-04-2026

It is certified that an inspection team headed by **Anil Kumar** (Name of Officers with designation) from **Assistant Engineer** (Name of Department/Office) inspected the **Sunbeam School, Robertsganj, Sonbhadra**. (Name and Address of the school) on **20.04.2026** (date of Inspection), checked the water test report submitted by the school and found that the school has potable drinking water for student and staff of the institution and is having provision for running water in the toilets and maintaining hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/State/U.T.Govt. The above is valid for a period of One Year issued on 20.04.2026


Anil

Signature with Seal : ..अधिशायसी. अभियन्ता..
Name : **Anil kumar** ..अधिशायसी, उ० प्र० जल निगम (ग्रामीण)
Designation : **Assistant Engineer**

Name & Address of the Office/Department:
Executive Engineer, Division Office,
U.p. Jal Nigam (Rural), Sonbhadra.

To
Sunbeam School,
Robertsganj, Sonbhadra.
(Name & Address of the Institution)

- The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with the original vernacular certificate as a single pdf.

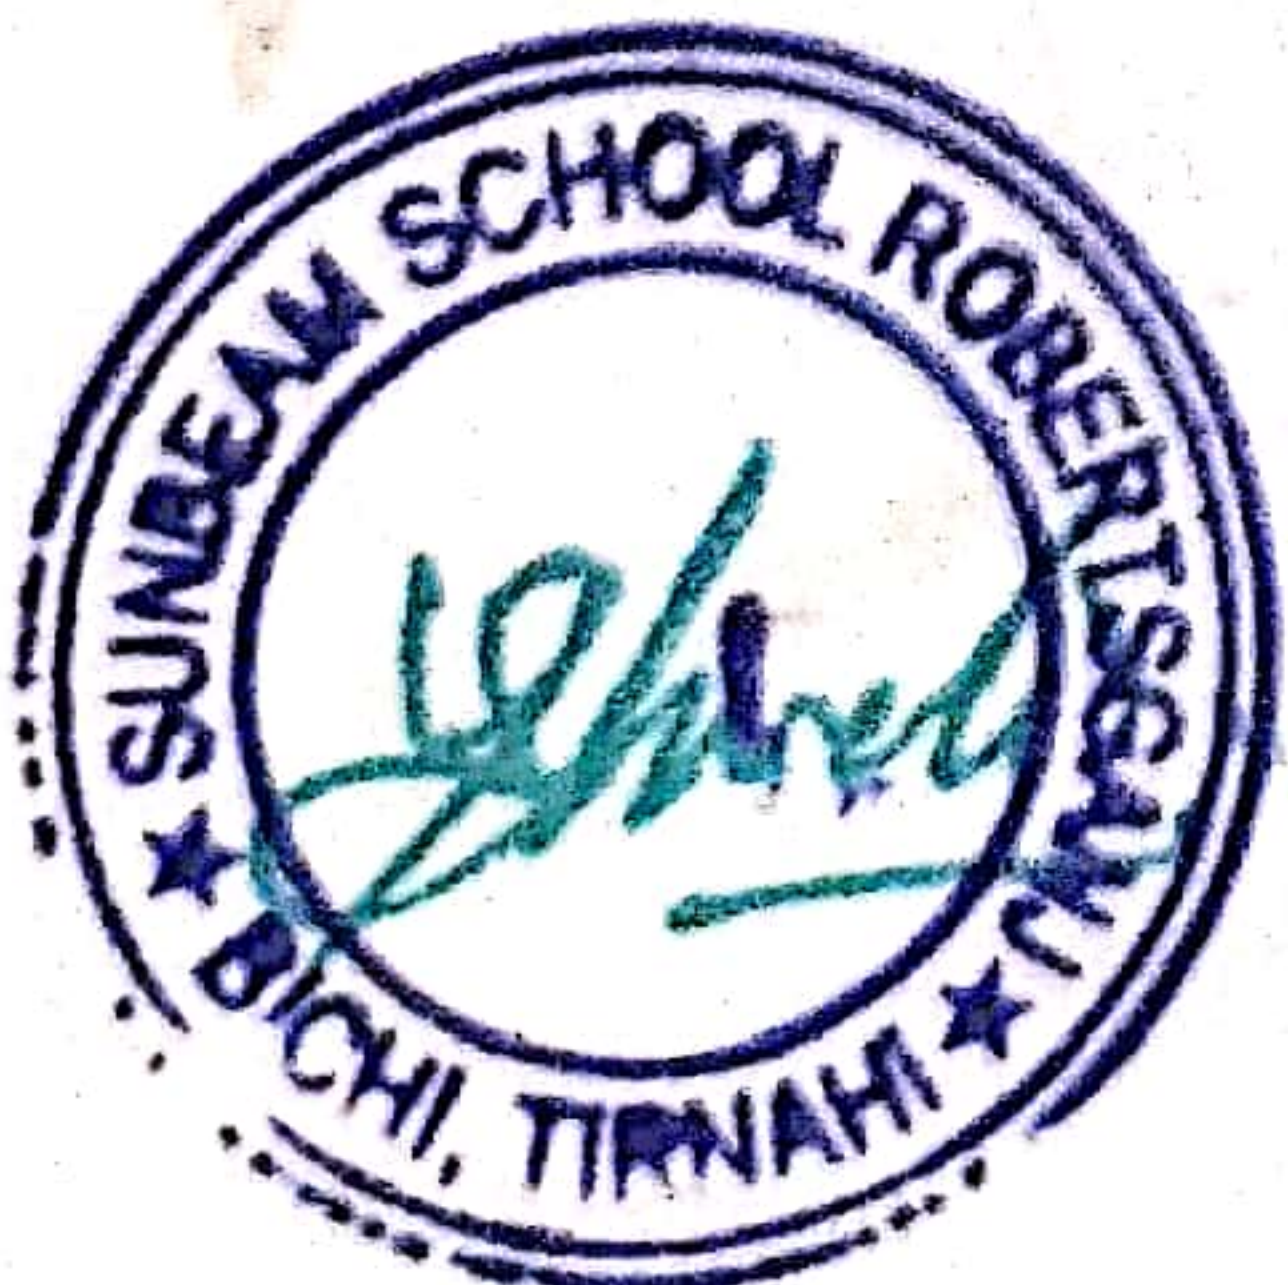

Manager
Sunbeam School Robertsganj

Jal Jeevan Mission

Har Ghar Jal

District Level Water Analysis Laboratory, U.P. Jal Nigam (Rural, Sonbhadra)
Unicef project unit (E&M): U.P. Jal Nigam, Parashipandey, Sonbhadra (Test Address only)

Test report

Sample
Id:

U2941646535875150

User Information

Name: Sunbeam School

Mobile: 9651780254

Email: patelpankajrbj18@gmail.com

Pin
Code: 231216

Full
Address: Village- Beechhi, Gram Panchayat- Beechhi, Block- Robertsganj, District- Sonbhadra, State- Uttar Pradesh

Sample description

Source
of
Sample: Beechhi tirnahi robertsganj

Village: Beechhi

Gram
Panchayat: Beechhi

Block: Robertsganj

District: Sonbhadra

State: Uttar Pradesh

Address:

Remarks:

Latitude: 24.717286

Longitude: 83.07017

Date & time of sample collection

09.04.2026 | 02:50:00 PM

Date & time of sample received in lab


09.04.2026 | 03:09:00 PM

Date & time of sample analysed

15.04.2026 | 05:07:00 PM

Date & time of report generation

16.04.2026 | 05:09:52 PM

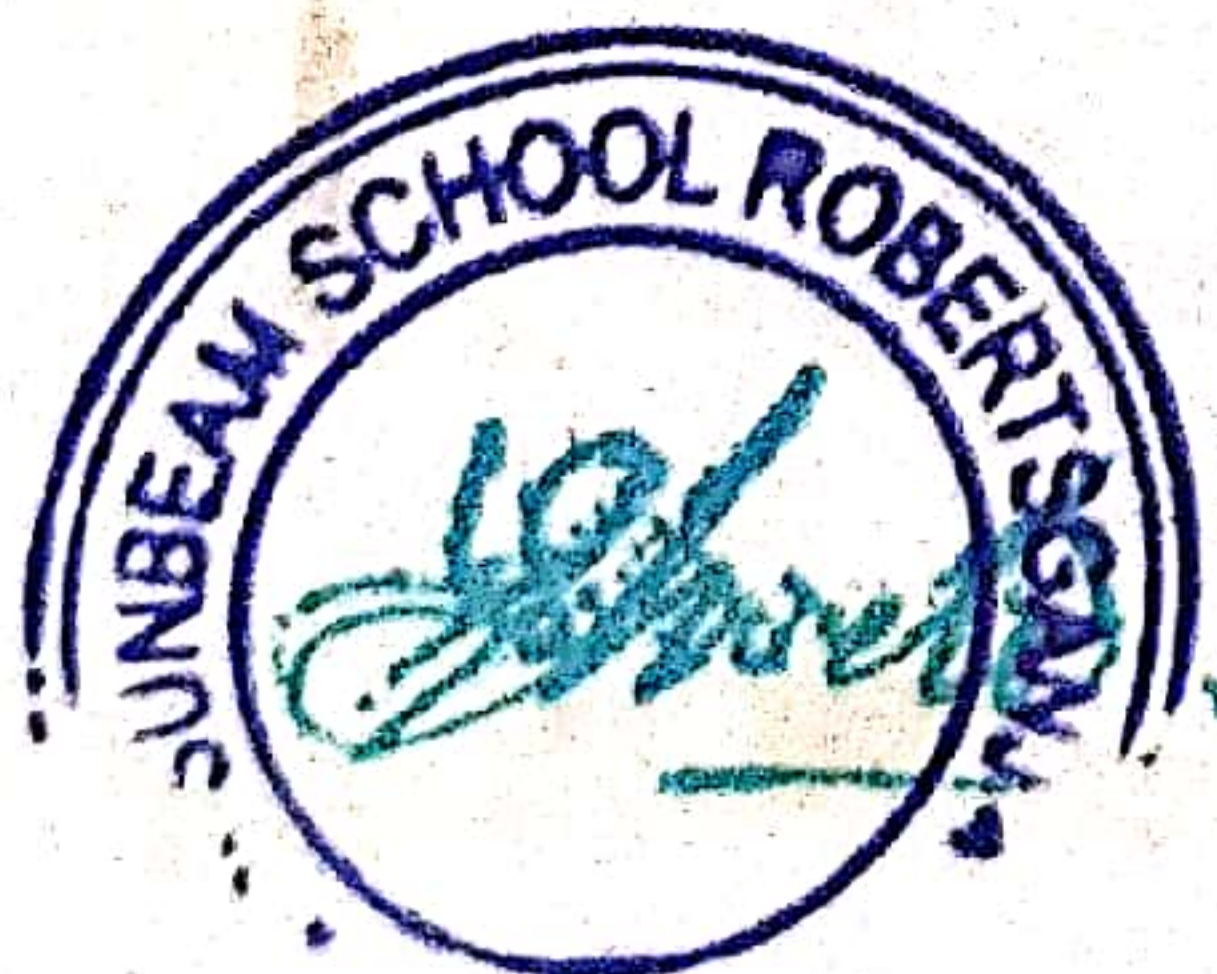

Manager
Sunbeam School Robertsganj

Test results


Sr. No.	Parameter	Unit	Specified limit (as per BIS 10500)	Permissible limit (as per BIS 10500)	Test result	Method of Analysis	Remarks
1	Calcium (as Ca)*	mg/l	75	200	32.064	EDTA Titrimetric method	
2	Chloride (as Cl)*	mg/l	250	1000	20.000	Argentometric method	
3	Conductivity*	micromhos per centimeter / microsiemens per centimeter	NA	NA	284.200	Electrometric method	
4	Fluoride (as F)*	mg/l	1	1.5	0.096	Ion selective electrode method	
5	Iron (As Fe)*	mg/l	1	No Relaxation	0.126	Phenanthroline method or as per IS 15303:2002 Electrothermal atomic absorption/Spectrophotometer method	
6	Magnesium (As Mg)*	mg/l	30	100	6.804	Calculation by APHA	
7	Nitrate (as NO ₃)*	mg/l	45	No Relaxation	9.464	UV-Visible Spectrophotometer	
8	pH*	NA	6.5-8.5	No Relaxation	7.084	Electrometric method	
9	Sulphate (as SO ₄)	mg/l	200	400	0.000	UV-Visible Spectrophotometer	BDL
10	TDS*	mg/l	500	2000	100.400	Gravimetric method	
11	Total Alkalinity (as Calcium Carbonate)*	mg/l	200	600	120.000	Titration method	
12	Total Hardness (As CaCO ₃)*	mg/l	200	600	108.000	EDTA Titrimetric method	
13	Turbidity*	NTU	1	5	0.120	Nephelometric method	

Note:

- 1)*Indicates parameters that are NABL accredited.
- 2)This test results related to the sample tested above
- 3)The report shall not to be reproduced in full without approval of authority
- 4)This is the end of the report

Data prepared by
Chemist: (Diwakar Mishra)

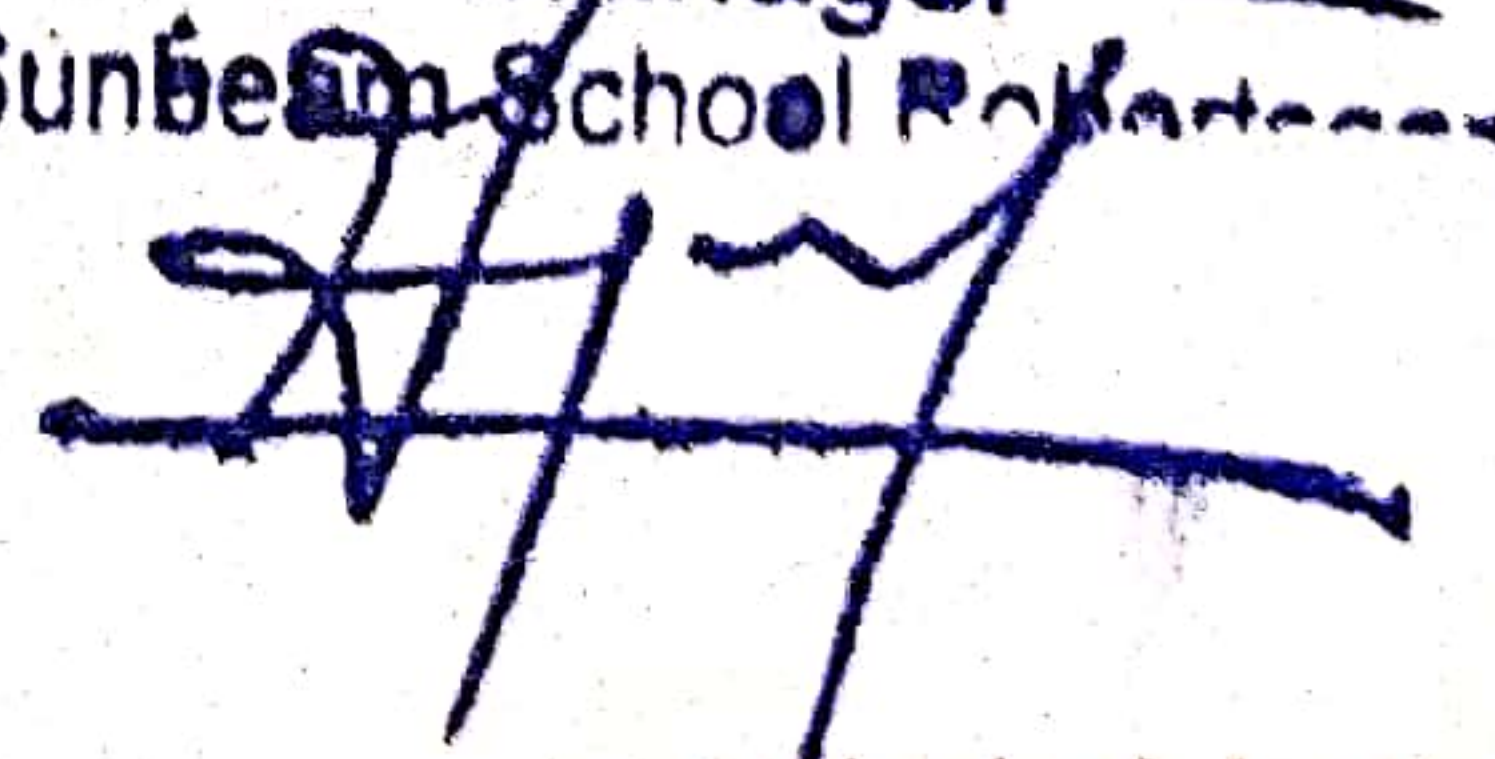

Manager
Sunbeam School Robertscam

Authorised signatory
Mr Ajit Kumar Pandey (Test Lab Incharge)